


PCNG4/5 Utility Specifications



Power, Water Supply, and Access Requirements

	<p>Receptacle Type: NEMA 5-15R 120 Vac, 15 Amp, Single Phase 1800 Watts Wire: 2W+G Hertz 50/60</p>
	<p>Water Supply Requirements Minimum Flow Rate: 1 GPM Water Connector: 1/4" Flare Water Pressure: 20-90 Psi</p>
	<p>Water shut-off valve to prevent back flow in accordance with local requirements.</p>
	<p>Drain pipe to floor drain (Optional) Copper or PVC in accordance with local health codes and regulations. Diameter: 2" or larger</p>

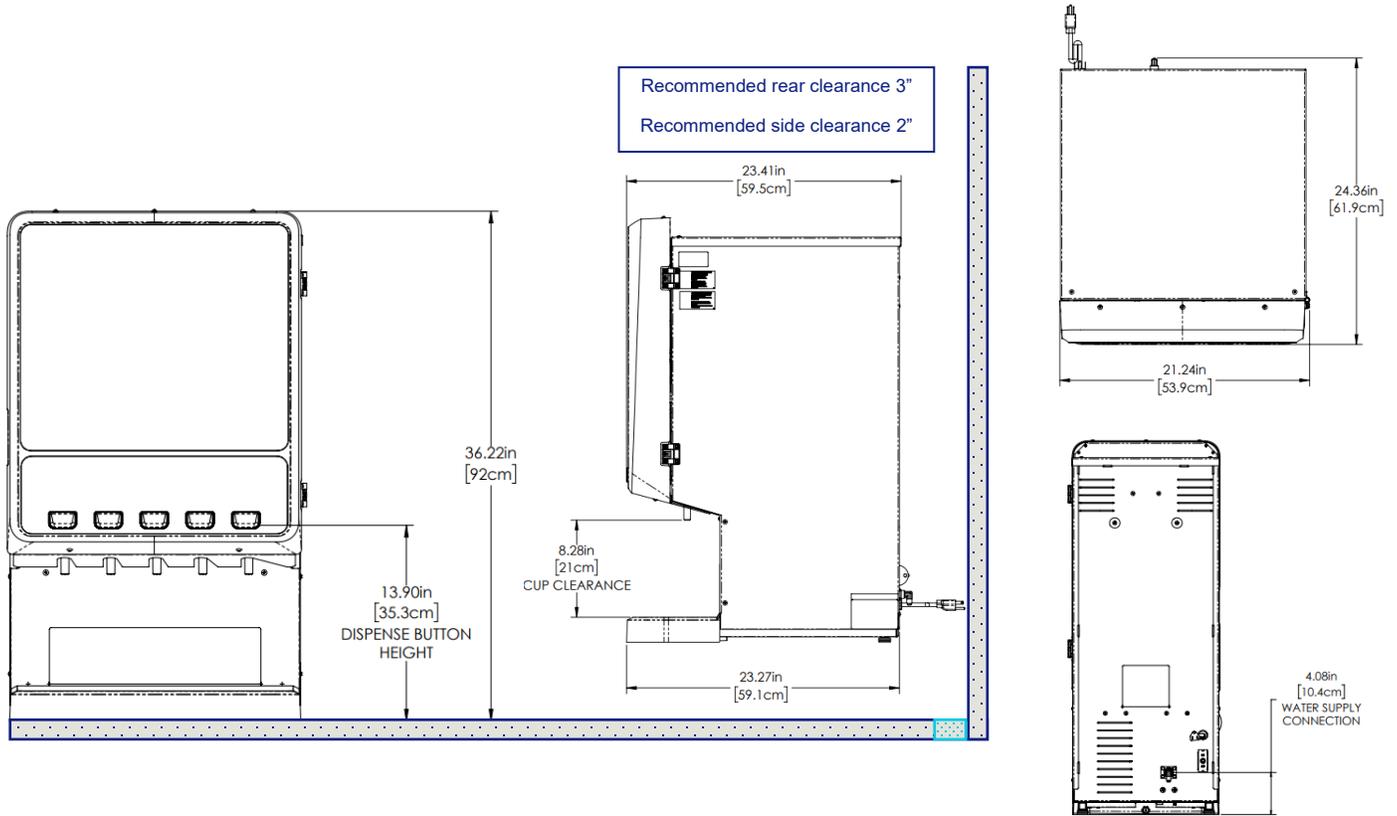

The receptacle, water shut-off valve and drain pipe must be within 6 feet of the center of the location (footprint) of the machine.



Water filtration system is required.
Recommended Wilbur Curtis approved water filter **CSC10AC00**.